


SECTION 03 30 01 – Slab for Electric Transformers & Switches

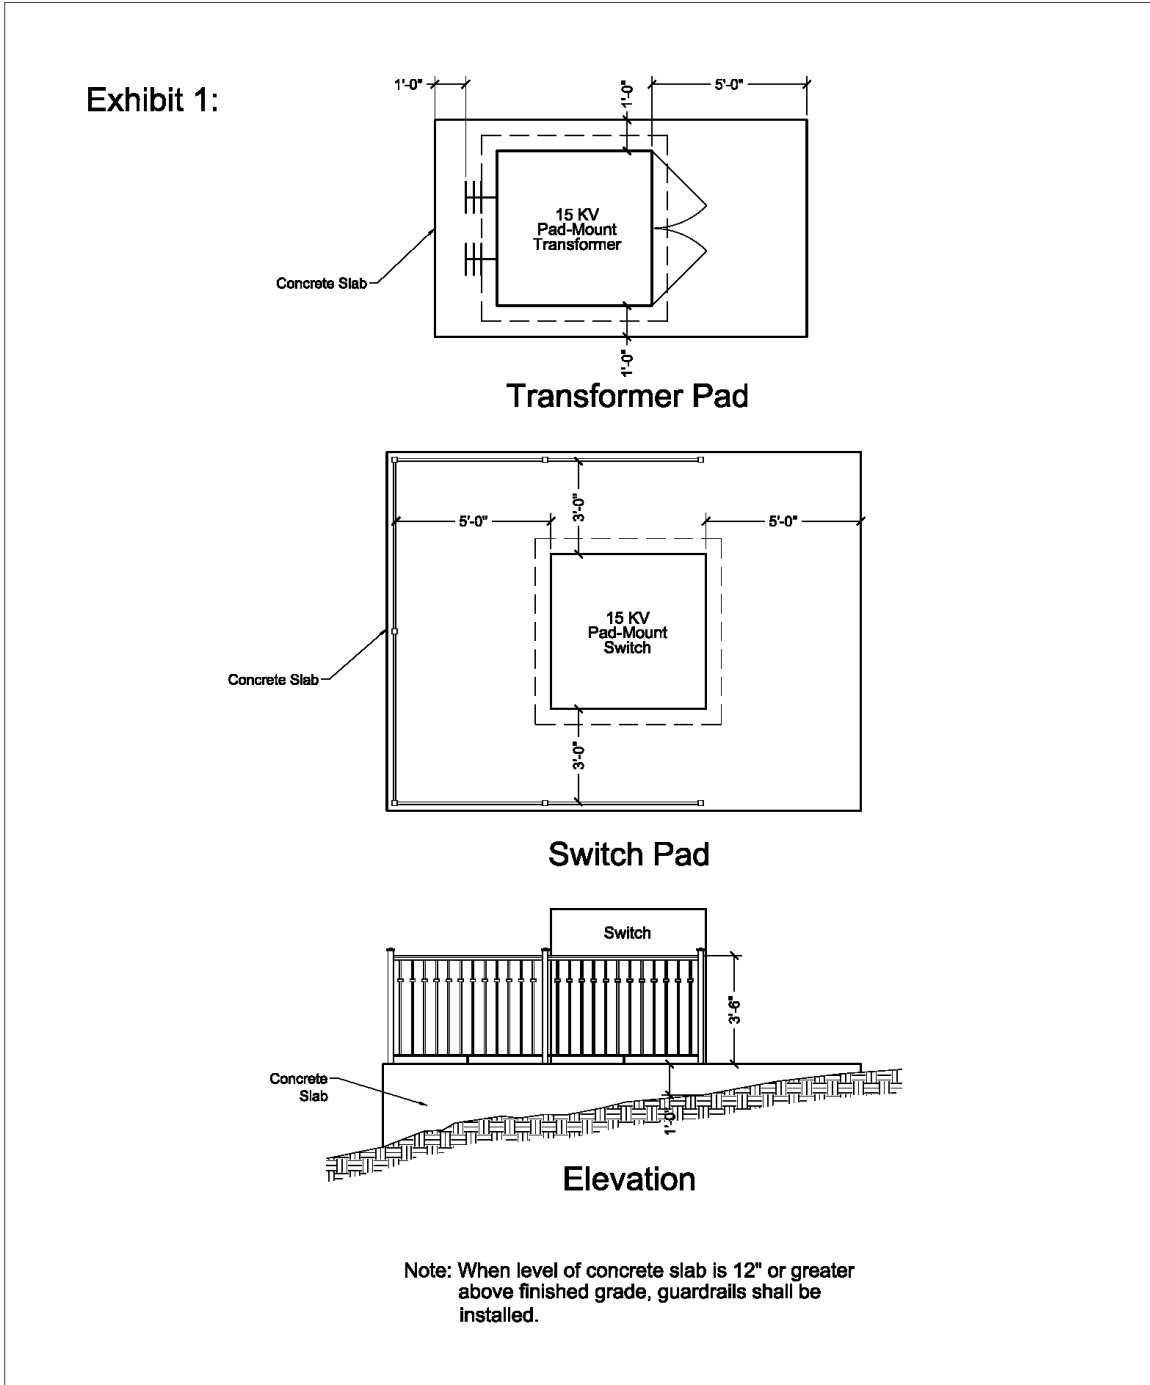

<p>TEXAS STATE 801 University Drive San Marcos, Texas 78666-4616 Phone: (512)245-2202 Fax (512)245-8839</p>	Title: Minimum Working Clearances		Sheet No.: 1 of 1
	15 KV Equipment		
	File updated: 5/28/2013	Plot Date: 5/28/2013	
	File name: 15kv Equip Pad		

END OF SECTION 03 30 01